



भारतीय समुद्रीय विश्वविद्यालय Indian Maritime University

(केन्द्रीय विश्वविद्यालय, भारत सरकार / A Central University, Govt. of India)
कोलकता परिसर / Kolkata Campus



IMU-KC/Water Purifier/22-23

Date: 30.06.2022

Sub: Quotation for Installation of RO Water Filtration Plant at 356 Boys Hostel of
IMU – Kolkata Campus

Sealed quotations are invited towards installation of RO Water Filtration Plant at the 356 Boys Hostel of Indian Maritime University – Kolkata Campus in the following format along with the scope of work:

Sl. No.	Scope of Work	Quantity	Unit	Rate per unit (in Rs.)	Applicable taxes per unit	HSN Code	Total rate per unit (including taxes)	Total Amount (Rs.)
A	B	C	D	E	F	G	H=E+F	I=CxH
1.	Civil Work: Earth Cutting; P.C.C.; Brick Work (375mm, 250mm,125mm); Filling with silver sand; Brick flat soling; R.C.C.; Reinforcement (8mm / 200mm c-c); Outside plaster; Material with labour complete the job	1 Job	1 Job					
2.	Finishing work for tile fixing, size (1.50 x 1) 1 box; Material with labour complete the job	1 Job	1 Job					
3.	Plumbing Work: Main supply line 1.5"/1.58" inlet of the 5000 litre tank; Another part of the plumbing, outlet of 200 litre tank & 3 taps fixing the wall; Material with labour complete the job	1 Job	1 Job					
4.	Electrical Work: a.L&T Starter: 02 nos. 32 Amp. MCB with Box. b.6 mm three core Polycab cable including pipe and laying. Material and labour complete the job.	Approx. 20 Mtr. plus other items	1 Job					

पी-19, तारातला रोड़, कोलकता -700 088 / P-19, Taratala Road, Kolkata - 700 088 Cntd...2
Phone : (033) 2401 4673 / 74 / 76 / 78 / 1946, Fax : (033) 2401 4333, Hostel : 2401 4675
E-mail : director.kolkata@imu.ac.in
Website : www.merical.ac.in & www.imu.edu.in

5.	Fabrication (27' x 10') h-10': a.M.S. truss-square tube-post 50mm x 50mm x 1.8mm b.Parling-40mm x 40mm x 1.8mm c.Siting-Colour coated profile sheet	270	Sq. Ft.				
6.	Fencing (25' + 25' + 8'4") h-10': Angle 18mm x 18mm, Net-1.8mm, Provisionally one gate as per your requirement	666	Sq. Ft.				

Estimated value of work: Rs. 3,35,000.00 including taxes

Eligibility Criteria of the firm for installation of RO Water Filtration Plant at IMU-KC:

- The Bidders should submit the valid GST registration.
- The Bidders should submit copy of PAN card.
- EMD:** Bidder should submit EMD amounting to Rs. 7,000.00 in the form of Demand Draft from any Nationalized Bank / Scheduled Bank drawn in favour of "**Indian Maritime University - Kolkata Campus**" payable at **Kolkata** along with their quotations. The firm may be exempted from submission of EMD if they submit valid MSME / NSIC Certificate.


Terms & Conditions:

- Bidders should quote their rates in the above format considering the above mentioned scope of work in their letterhead with official stamp and signature.
- The rates quoted should be inclusive of all but excluding taxes, which should be stated separately.
- The rates quoted should be valid for two months from the last date of submission of quotation.
- The Security Deposit or Performance Bank Guarantee @ 5% of the value of Work Order has to be submitted by the successful bidder within one week from the date of the Work Order.
- Prospective bidders may visit the campus at P-19, Taratala Road, Kolkata – 700 088 before submission of their quotations.
- Submission of multiple bids by a single firm will lead to rejection of the bids and IMU-KC may black list such firms from future participation.
- Last date of submission of quotation is 18.07.2022.
- The work should be completed within 15 days from the date of issue of Work Order.
- E-invoicing is mandatory as per Notification No. 61/2020 – Central Tax dated 30.07.2020.
- The quotation is to be submitted in sealed envelope clearly subscribing "Quotation for installation of RO Water Filtration Plant at IMU-KC".
- The envelope should be addressed to the Dy. Registrar, Indian Maritime University, P – 19, Taratala Road, Kolkata — 700 088 and deposited in the Tender Box kept at the Dy. Registrar's office (1st floor, Room No. 130) or can be sent by post.
- The envelopes are to be sealed properly with gum and not by stapler pin.
- Evaluation of the quotations would be done based on the L1 on total amount quoted by the firms.
- Notwithstanding anything specified in this letter inviting quotation, IMU-KC at its sole discretion, unconditionally and without assigning any reason, reserves the right:
 - To accept or reject lowest bid or any other bid or all the bids.
 - To accept any bid in full or in part.
 - To reject the bid offer not conforming to the tender conditions.
- Payment would be made through bank transfer on quarterly basis after submission of the bill which has to be certified by the respective O.I.C.
- The indicative diagrams of the work are provided in the attached Annexures.

Anandhi 30/6/22
O.I.C. - Purchase



SCHEMATIC DIAGRAM OF WATER FILTRATION UNIT (INDICATIVE)

8230 mm / 27 ft.

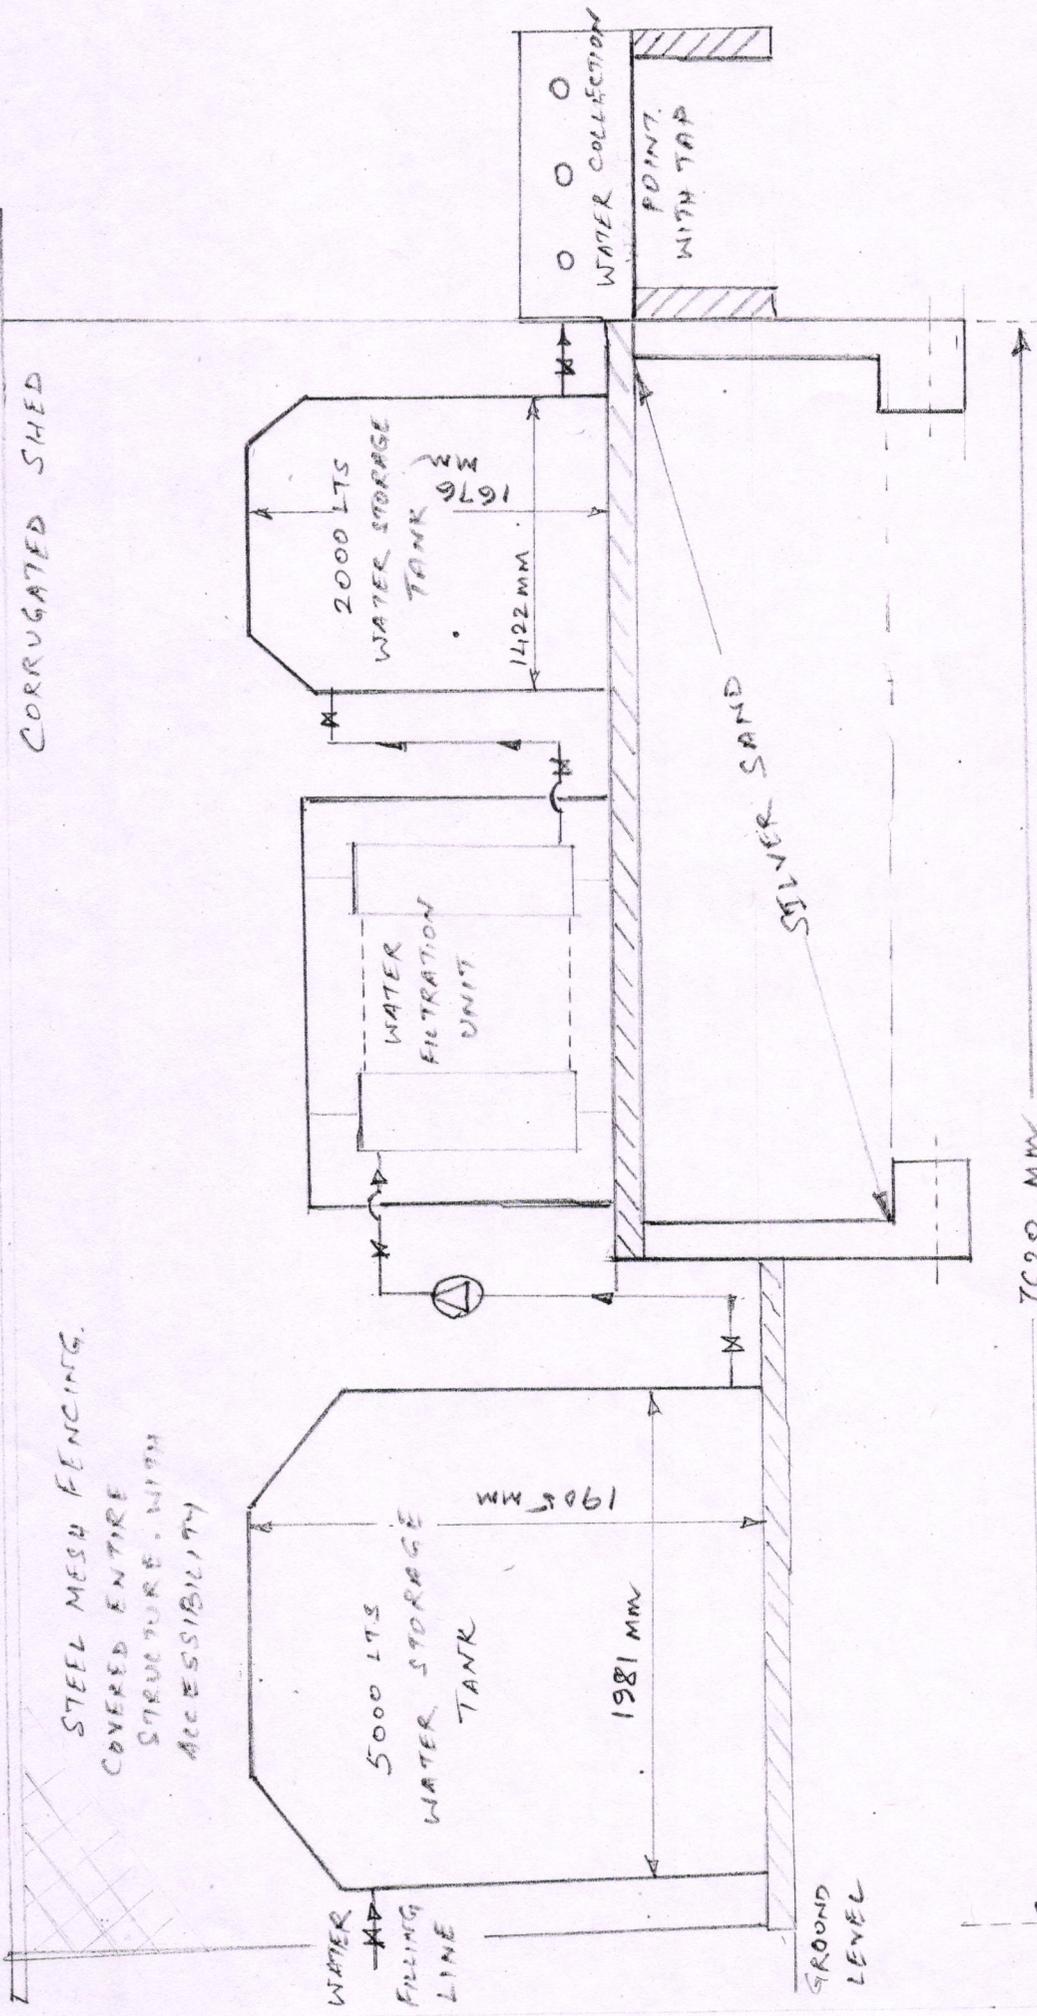


7620 mm (25 ft.)

Amir

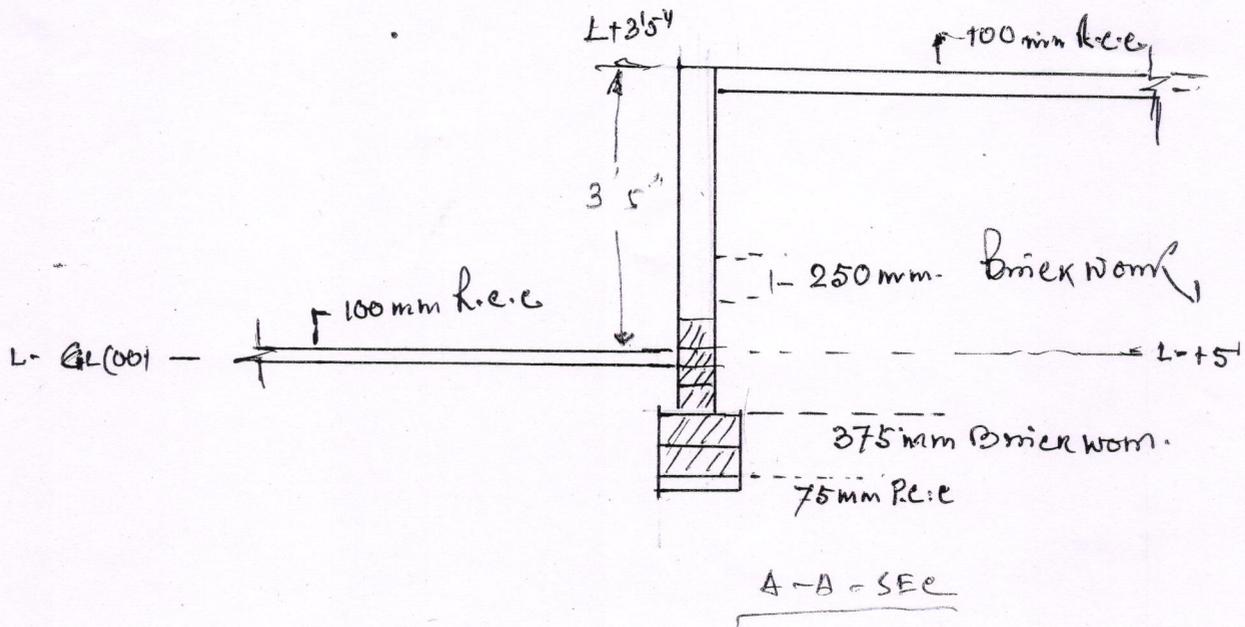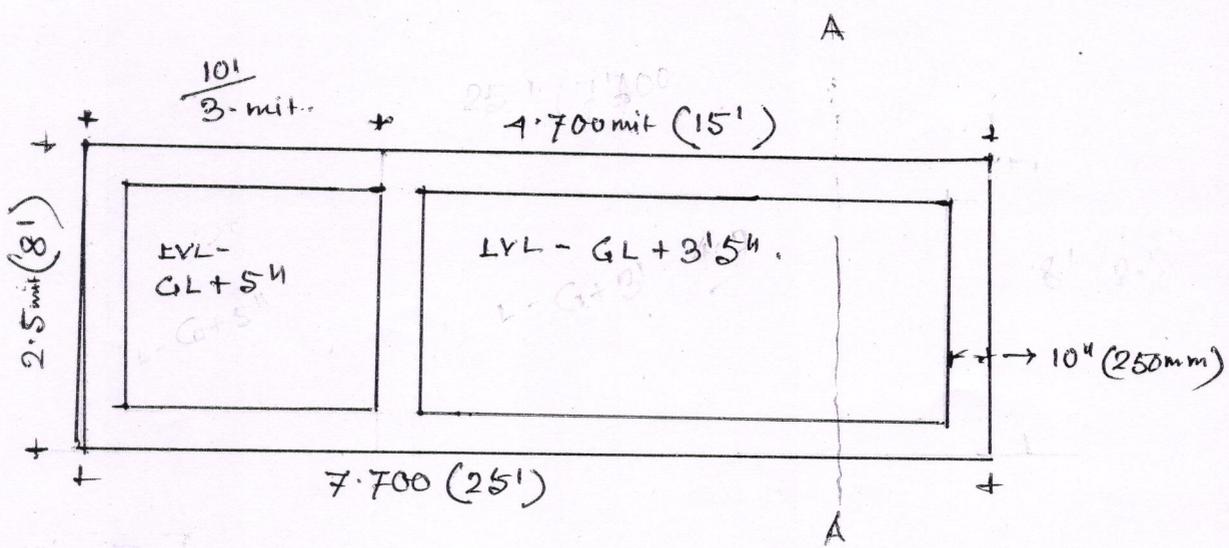

FOUNDATION

Amshij

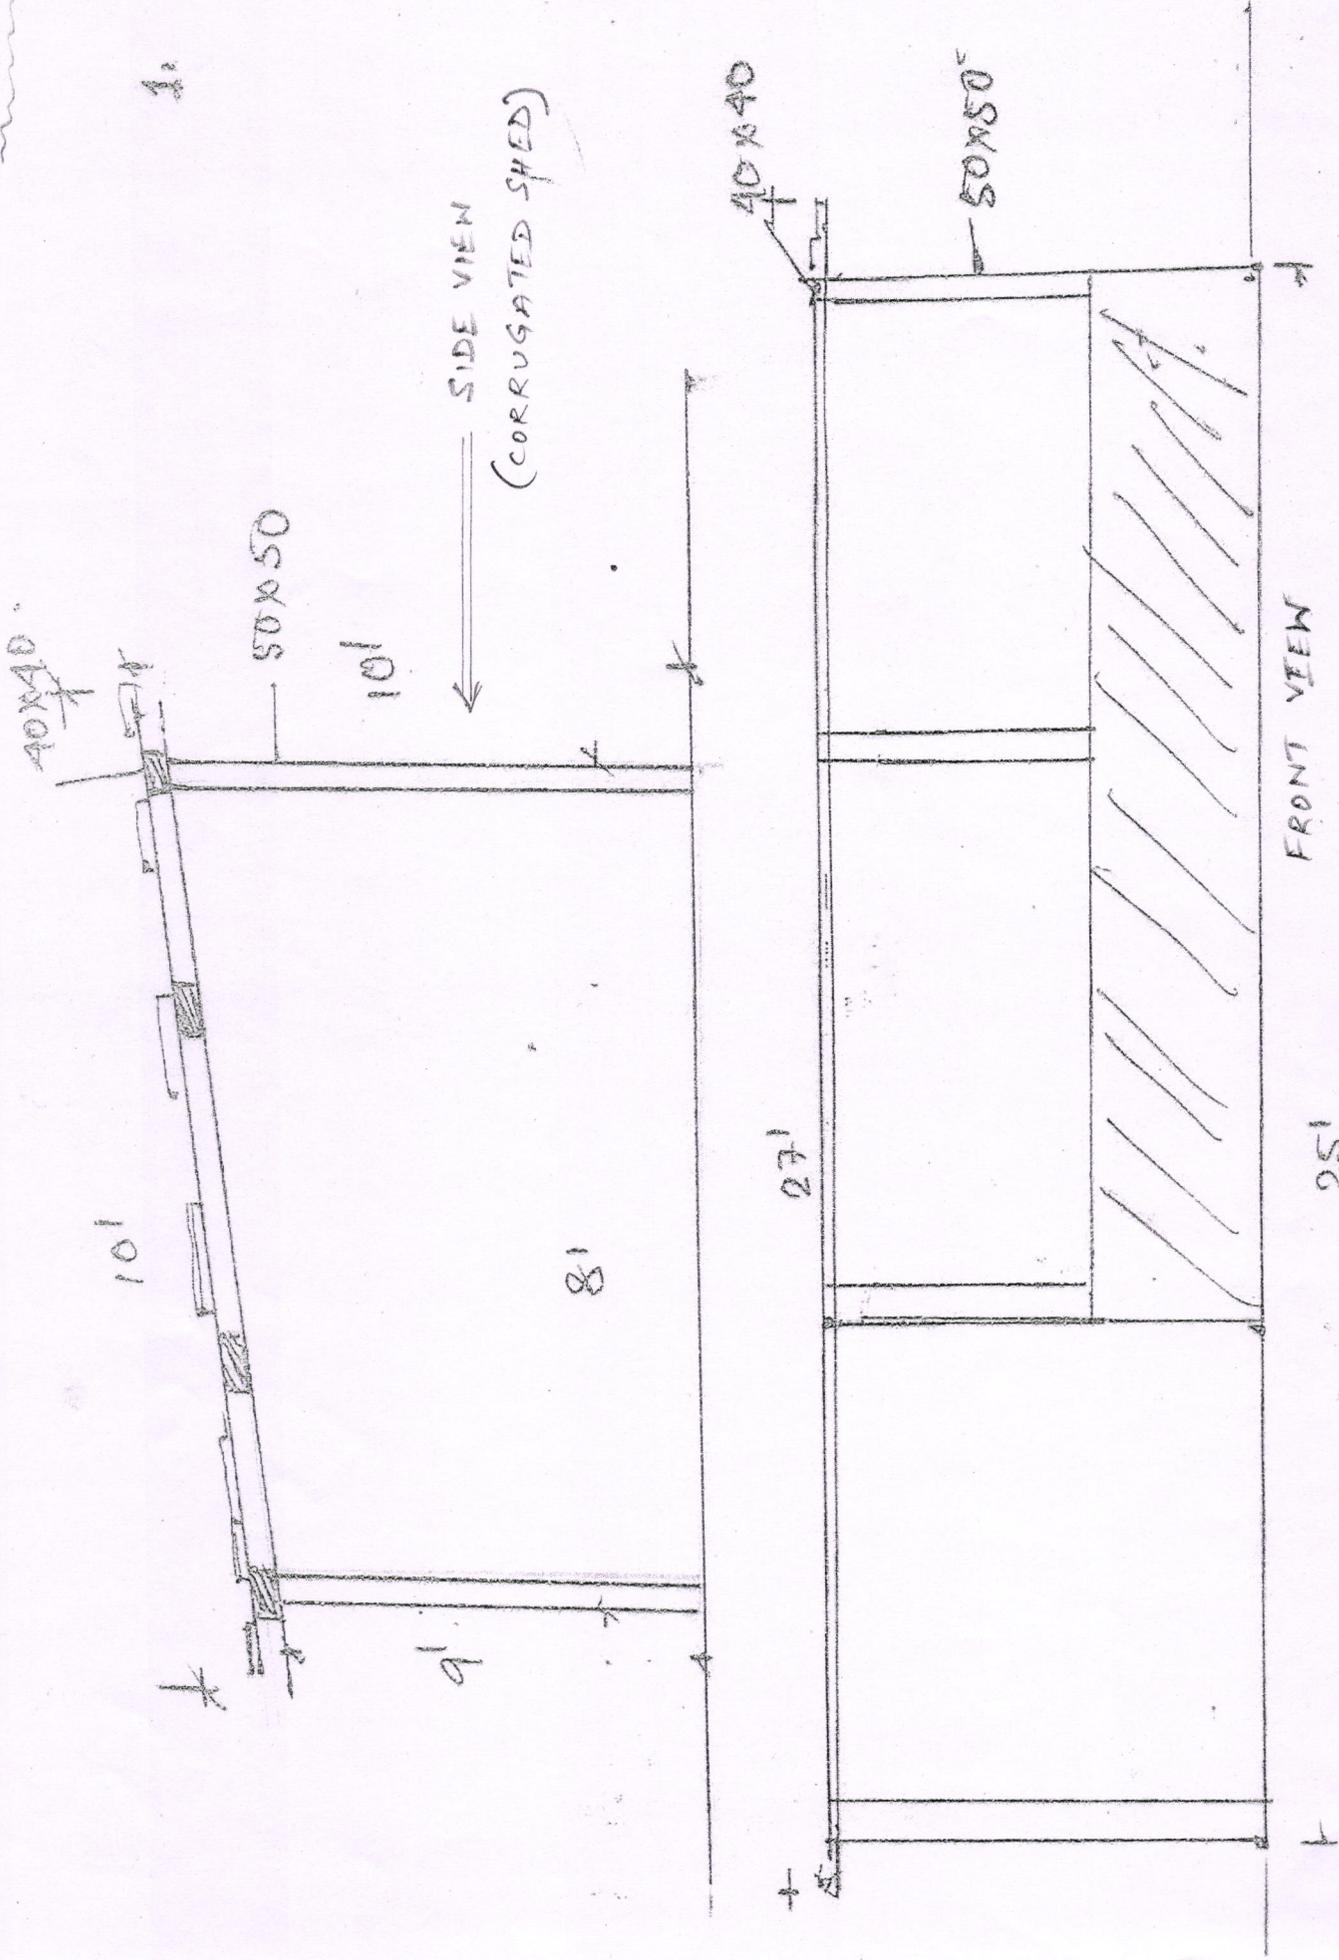

Amulya